


INSTALLATION DATA

*FOR USE IN STATIC SYSTEMS

MULTISECTION U.L. CLASSIFIED 1½" HOUR*
CURTAIN TYPE FIRE DAMPER
MODEL 150A-B-C

VERTICAL INSTALLATION

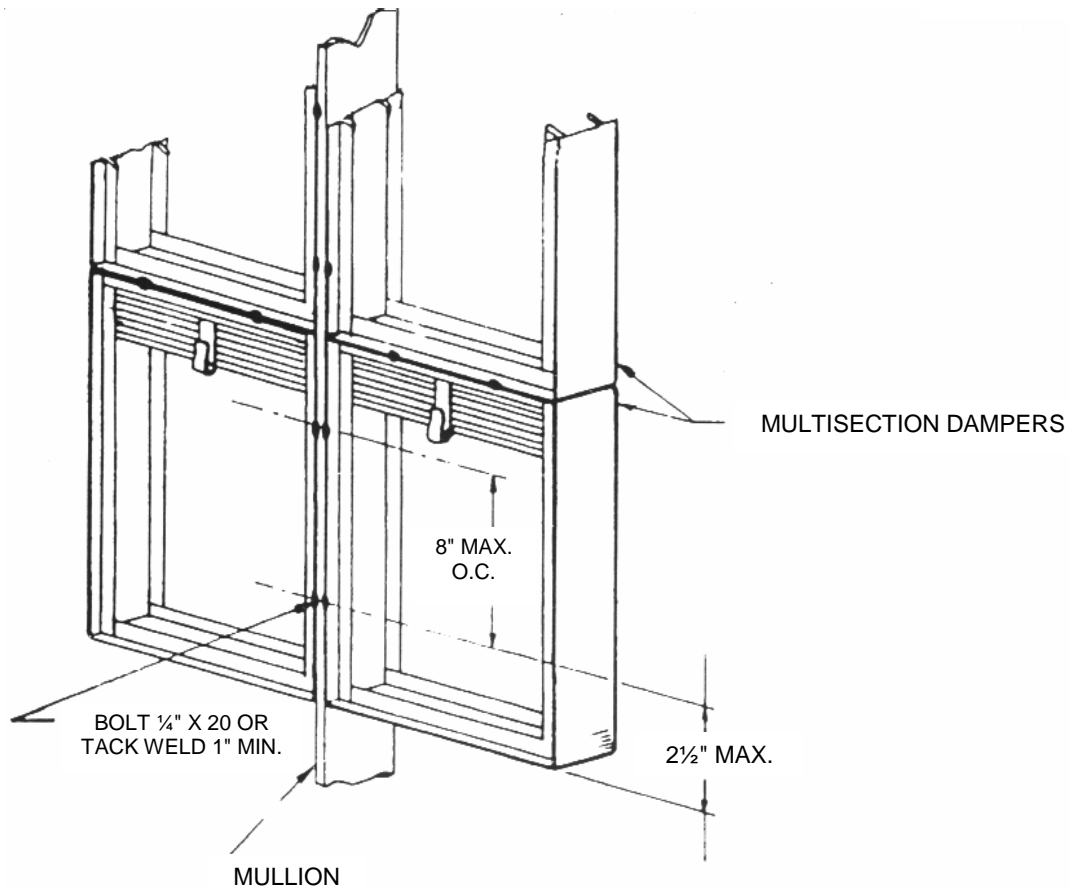

MULLION INSTALLATION DETAIL

Notes: Mullion shall be made of flat 14 gauge galvanized steel and 47/8" wide. Mullion length shall be placed between adjoining damper frame and welded or bolted with 1/4" bolts and nuts using indicated spacing.

Multisection damper assembly 97"W x 42"H are made up from single unit not exceeding 40"W x 40"H (1½ hr. Vertical).

To maintain Buckley's policy of continuous improvement, we reserve the right to change prices, specifications, ratings or dimensions without notice or obligation. Manufactured by Sheet Metal Union Local 17.

MANUFACTURED BY: *Buckley Associates, Inc.* HANOVER, MA

Visit us on the World Wide Web at: <http://www.buckleyonline.com>

