


Submittal Data

Acoustical Low-Pressure Flexible Buck Duct

Construction Features

Buckley's Acoustical Low-Pressure Aluminum Buck Duct is comprised of an all-aluminum perforated core with an open area of 20-25%. The perforated inner duct is enclosed in a 2" thick fiberglass insulation. The outer jacket is UL approved and available in either black polyethylene (BDAP) or reinforced aluminum (BDAM) options.

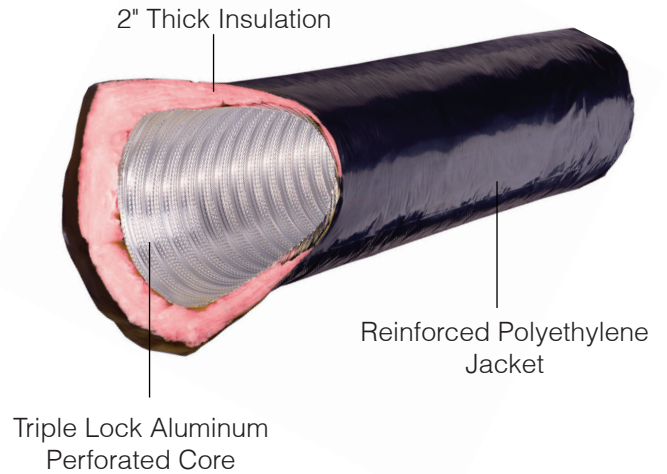

Technical Data

Standard Lengths (Feet).....5' or 10'
 Inside Diameter (Inches).....5"-10", 12",14",16"
 Inside Bend Radius (Inches).....Min. ½ x 1 Diameter
 Air Friction Loss.....See Friction Loss Chart
 Vapor Barrier Permeance......1 Perm per A.S.T.M
 E-96-66, Procedure A
 UL ListingUL 181, Class 1 Air Duct
 Standards.....NFPA 90A AND 90B
 Codes.....HUD/FHA MIN. Property Std.
 Rated Velocity (F.P.M.).....5500 F.P.M.
 Internal Working Pressure (W.G.).....2" w.g. positive
 1" w.g. negative
 Minimum Burst Pressure.....2 ½ times working pressure
 Operating Temperature Range.....-40° to +250° F
 Flame Spread.....Less than 25
 Smoke Developed.....Less than 50
 Thermal Conductance.....C Factor, not more than .23
 R-Value.....6.0

Noise Reduction db (5' ft length, 8" inch diameter)

Octave Band	2	3	4	5	6	7	8
HZ	125	250	500	1000	2000	4000	8000
Model BDAP Buck Duct Acoustical Polyethelene	-2	-16	-17	-18	-13	0	+3

About Our Tests

Our tests were conducted by Energistics Laboratory, an independent research development facility. All testing and rating procedures used by the laboratory are accordance with ARI, ADC, ISO, and ASHRAE standards as applicable. The results of the testing are based on test results of sound collected on various types of eight-inch round Buck Duct specimens. Each test sample was tested at a velocity of 500 FPM and was then compared to hard metal duct at the same velocity. For the purpose of these tests, the only comparison made is test specimens to hard duct.

Buckley Associates, Inc.

Manufactured by Buckley Associates, Inc, Hanover, Massachusetts
 Sheet Metal Union Local 17.



Buct Duct BDAP/M
 March 2019

